


THE "NOWRA" 4850 LITRE SEPTIC TANK

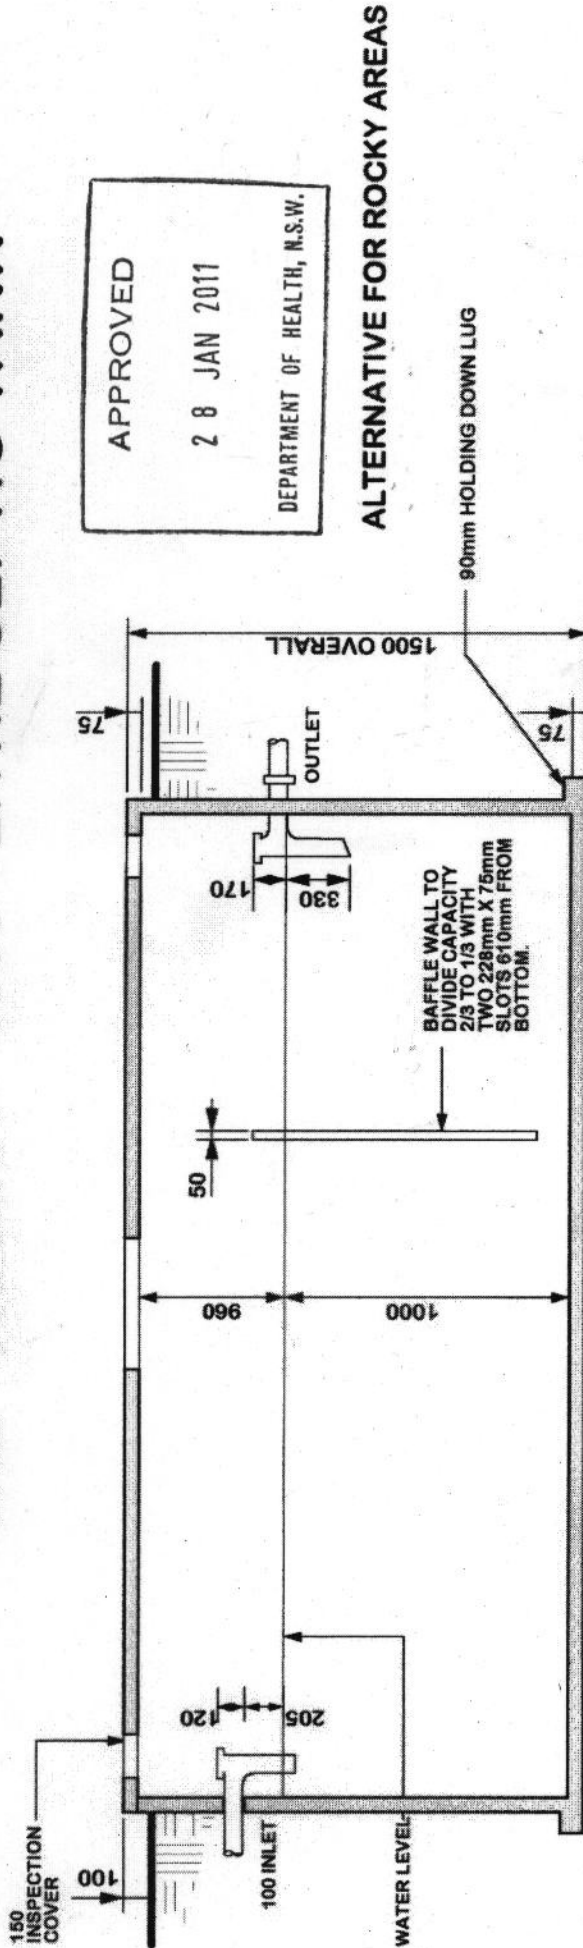

APPROVED
28 JAN 2011
DEPARTMENT OF HEALTH, N.S.W.

ALTERNATIVE FOR ROCKY AREAS


NOTES/ SPECIFICATIONS

- When an installed unit is likely to displace ground water, The excavation is to be permanently drained or alternately, The unit is to be adequately anchored to prevent movement of the empty vessel.
- Concrete reinforced with fibre steel, minimum concrete strength 35mpa after 28 days.
- All measurements in millimetres.

DETAILS

Name: _____ Street: _____
 Lot: _____
 Locality: _____
 Shire/ Mun: _____
 No Of Persons: _____

Sectional Elevation

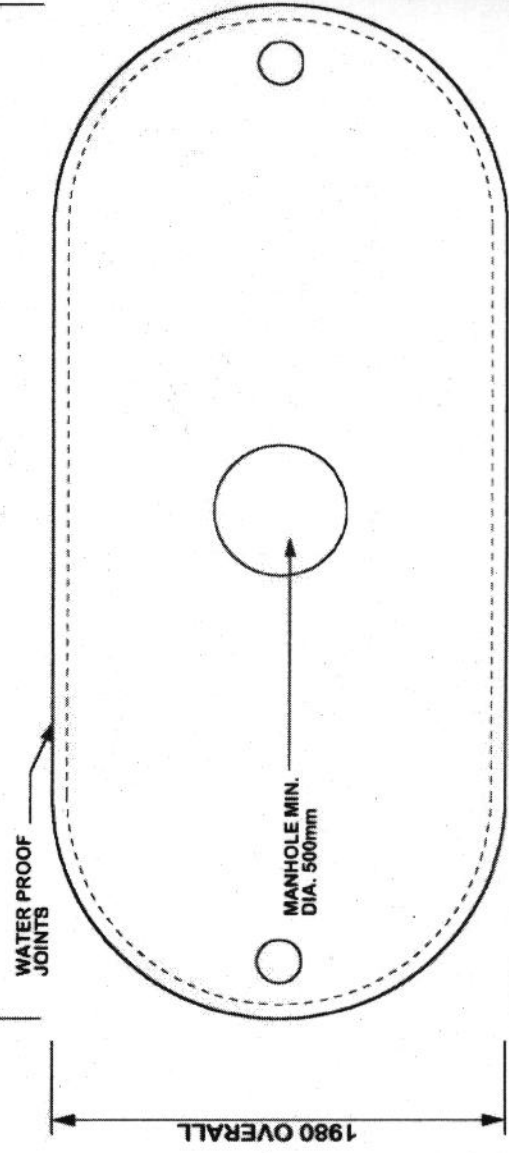

Plan

286 Princes Highway
 South Nowra PO Box 214
 Nowra 2541
 Tel/ Fax (BH) 0244 223 861
 Tel (AH) 0244 221 902
 A.C.N No 061 949 349

bennett's
 concrete products