



THE "NOWRA" COLLECTION WELL

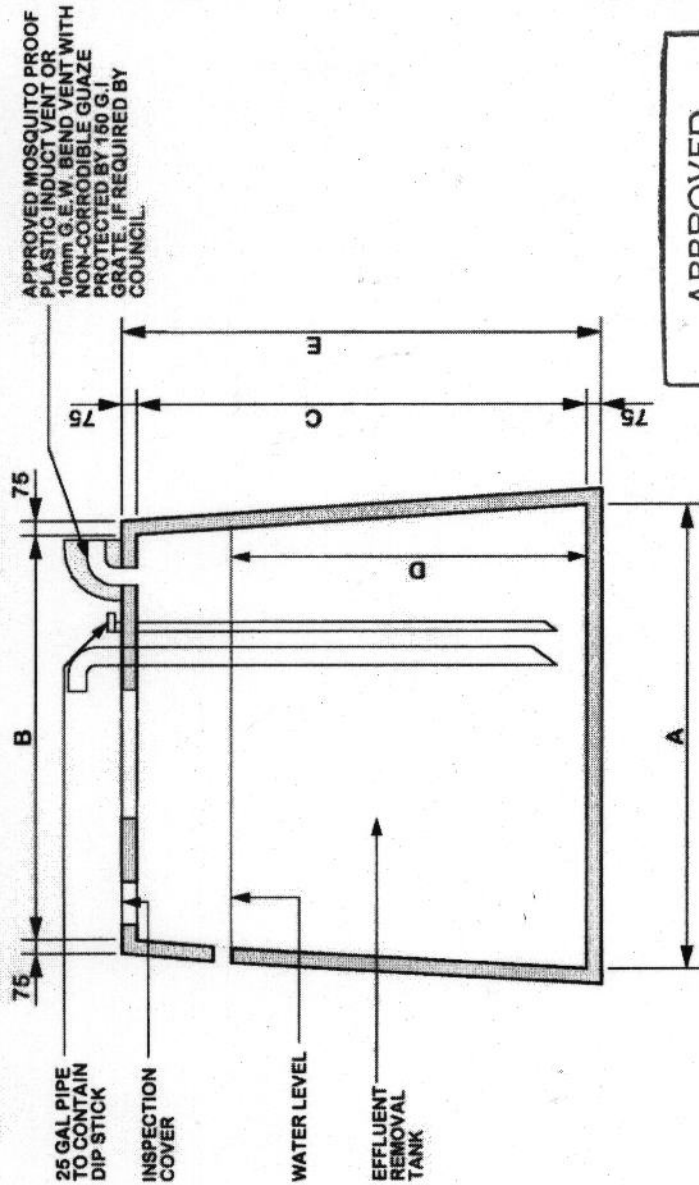

Sectional Elevation

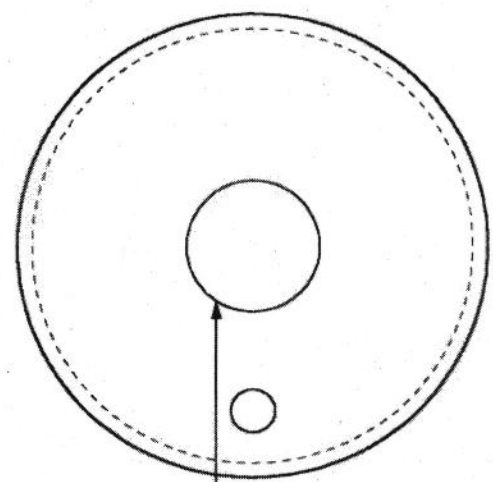

Plan

APPROVED
2 8 JAN 2011
DEPARTMENT OF HEALTH, N.S.W.

NOTES/ SPECIFICATIONS

- When an installed unit is likely to displace ground water, The excavation is to be permanently drained or alternately, The unit is to be adequately anchored to prevent movement of the empty vessel.
- All measurements in millimetres.
- Tank cast in one piece, With tapered finish to resist floatation.
- Concrete reinforced with a.s f41 mesh or equivalent. minimum concrete strength 32mpa after 28 days.
- Concrete reinforced with fibre steel, minimum concrete strength 35mpa after 28 days.

LEGEND

Mark	A Bottom Dia.	B Top Int Dia.	C Int. Height	D Liquid Depth	E Overall Height	CAPACITY LITRES
	1600	1500	1450	1185	1600	2050
	1810	1810	1430	1015	1580	2800
	1690	1785	1880	1550	2035	3550
	1900	1830	2080	1730	2230	4450

DETAILS

Name: _____

Lot: _____ Street: _____

Locality: _____

Shire/ Mun: _____

No Of Persons: _____

bennett's
concrete products

286 Princes Highway
South Nowra PO Box 214
Nowra 2541
Tel/Fax (BH) 0244 223 861
Tel (AH) 0244 221 902
A.C.N No 061 849 349